


**GALVASHIELD® XPT ANODES
GENERAL NOTES**

1. REMOVE DAMAGED CONCRETE AND CLEAN STEEL AS PER STANDARD ICRI REPAIR METHODS.
2. ENSURE EXPOSED REINFORCING STEEL IS SECURELY FASTENED WITH TIE WIRE TO PROVIDE GOOD ELECTRICAL CONTINUITY.
3. ATTACH GALVASHIELD® XPT ANODES TO CLEAN STEEL AT AN EVEN SPACING WITHIN THE REPAIR AREA. PLACE THE ANODE AS CLOSE AS POSSIBLE TO THE INTERFACE BETWEEN THE REPAIR AND THE PARENT CONCRETE (WITHIN 4 INCHES (100MM) WHILE STILL ALLOWING THE REPAIR MATERIAL TO ENCASE THE ANODE.
4. GALVASHIELD® XPT ANODES ARE TO BE INSTALLED PER THE DESIGN DRAWINGS AND SPECIFICATIONS ALONG THE PERIMETER OF THE REPAIR AREA AFTER ALL CHLORIDE CONTAMINATED CONCRETE HAS BEEN REMOVED. ADDITIONALLY, IF ANY CHLORIDE CONTAMINATED CONCRETE REMAINS WITHIN OR BELOW THE REPAIR AREA AND IS IN CONTACT WITH ANY LAYER OF REINFORCING STEEL THEN IT MAY BE NECESSARY TO PLACE GALVASHIELD® XPT ANODES IN A GRID PATTERN WITHIN THE INTERIOR OF THE REPAIR AREA.
5. TEST ELECTRICAL CONTINUITY OF THE REINFORCING STEEL BEFORE INSTALLATION AND REPAIR AS NECESSARY. TEST ELECTRICAL CONTINUITY OF ANODE CONNECTION TO REINFORCING STEEL AFTER INSTALLATION. A DC VOLTAGE MEASUREMENT OF $\leq 1\text{mV}$ CONFIRMS GOOD CONTINUITY.
6. POUR BACK REPAIR AREA WITH COMPATIBLE REPAIR MATERIAL AS PER PROJECT SPECIFICATIONS.

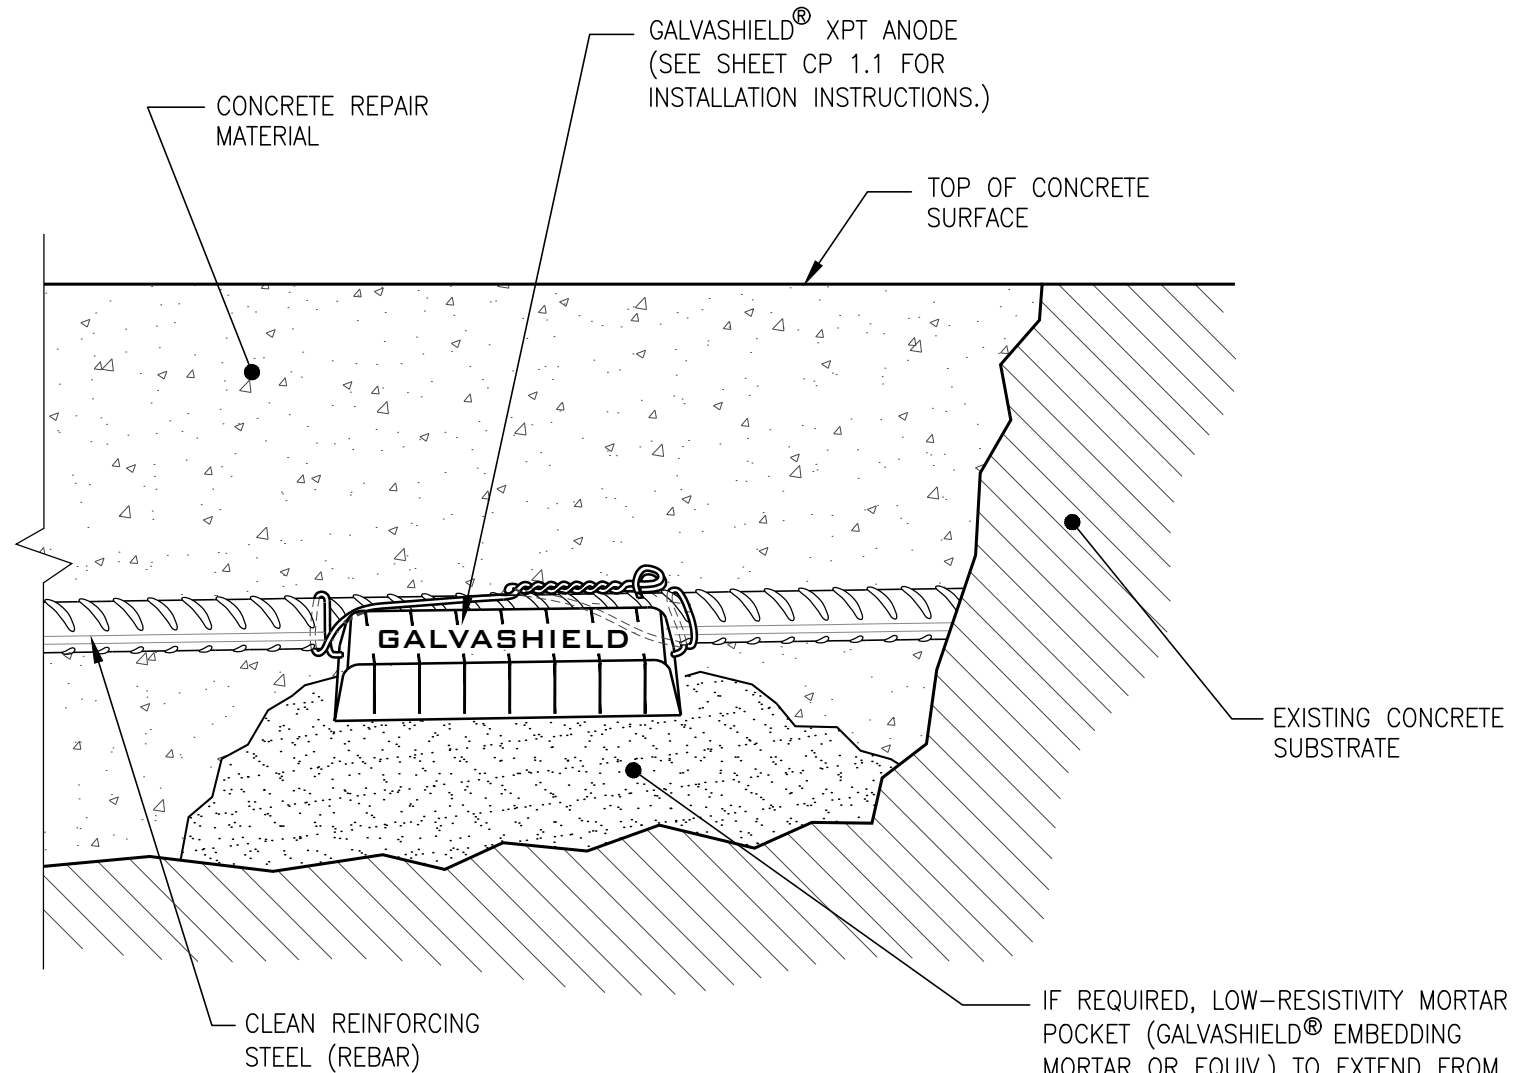

**1 SECTION VIEW
GALVANIC ANODE INSTALLATION DETAIL**
SCALE: N.T.S.

REQUIRED WHERE CONCRETE REPAIR MATERIAL HAS A SATURATED BULK RESISTIVITY HIGHER THAN 50,000 OHM-CM.

| DRAWING REVISIONS | | | |
|-------------------|---------|------|-------------|
| # | DATE | BY | DESCRIPTION |
| 1 | 6/12/23 | S.Y. | |
| | | | |
| | | | |
| | | | |



**GALVASHIELD® ANODES
CORROSION PROTECTION**

**GALVASHIELD® XPT SINGLE
WIRE CONNECTION
GENERAL NOTES**

VECTOR CORROSION TECHNOLOGIES
800 WINCHESTER ROAD,
SUITE 175,
LEXINGTON, KY 40505
PH: 813-830-7566
VECTOR-CORROSION.COM

PROJECT NO.

DRAWING NO.

CP-1.0

| DRAWING REVISIONS | | | |
|-------------------|---------|------|-------------|
| # | DATE | BY | DESCRIPTION |
| 1 | 6/12/23 | S.Y. | |
| | | | |
| | | | |
| | | | |





**GALVASHIELD ANODES
CORROSION PROTECTION**



**GALVASHIELD XPT SINGLE
WIRE CONNECTION
GENERAL NOTES**

VECTOR CORROSION TECHNOLOGIES
800 WINCHESTER ROAD,
SUITE 175,
LEXINGTON, KY 40505
PH: 813-830-7566
VECTOR-CORROSION.COM

PROJECT NO.
DRAWING NO.
CP-1.1

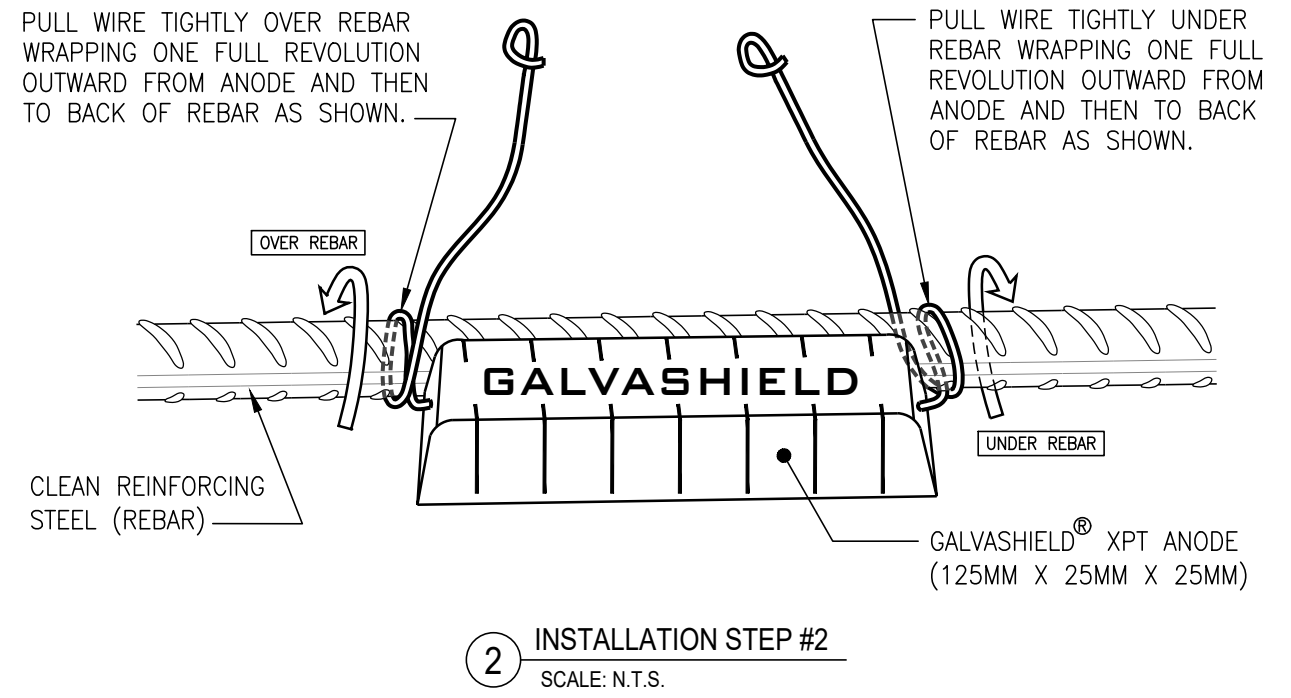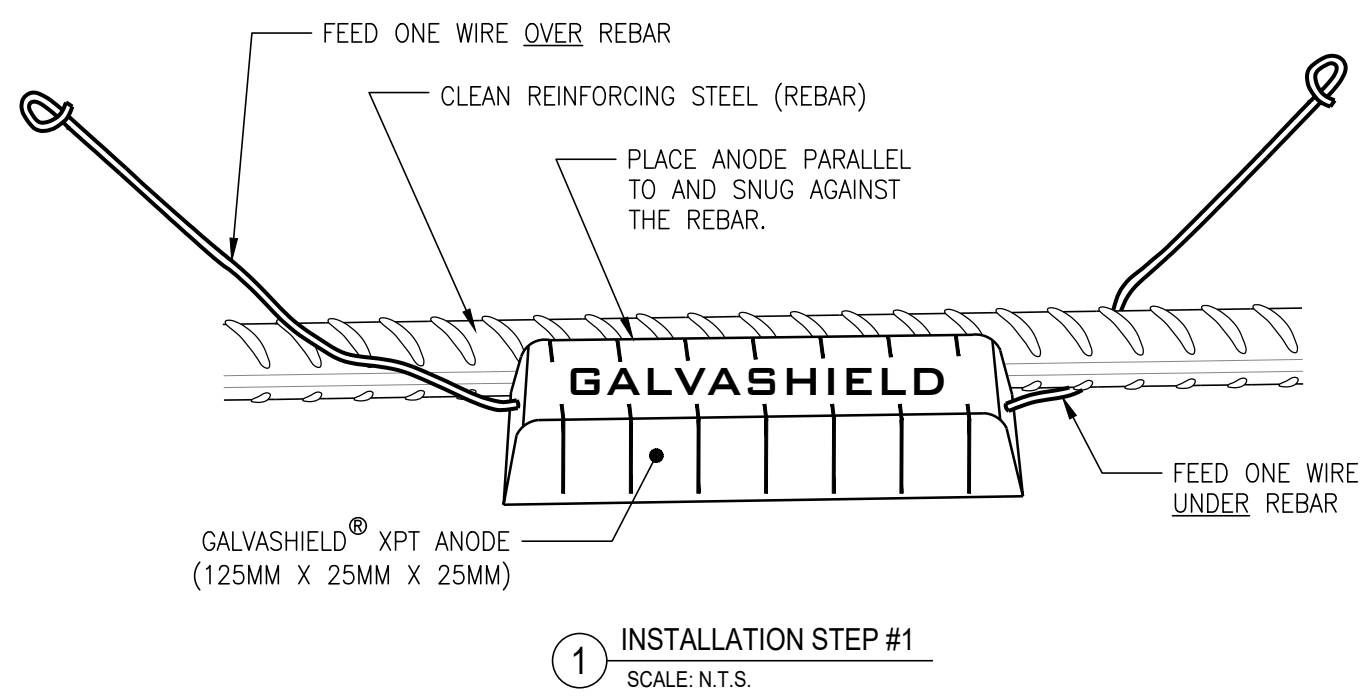

ANODE ORIENTATION NOTE: ANODES MAY BE INSTALLED AS SHOWN WITH THE WIDER SIDE ON THE BOTTOM, OR MAY BE ROTATED 180-DEGREES TO HAVE THE WIDER SIDE AT THE TOP.

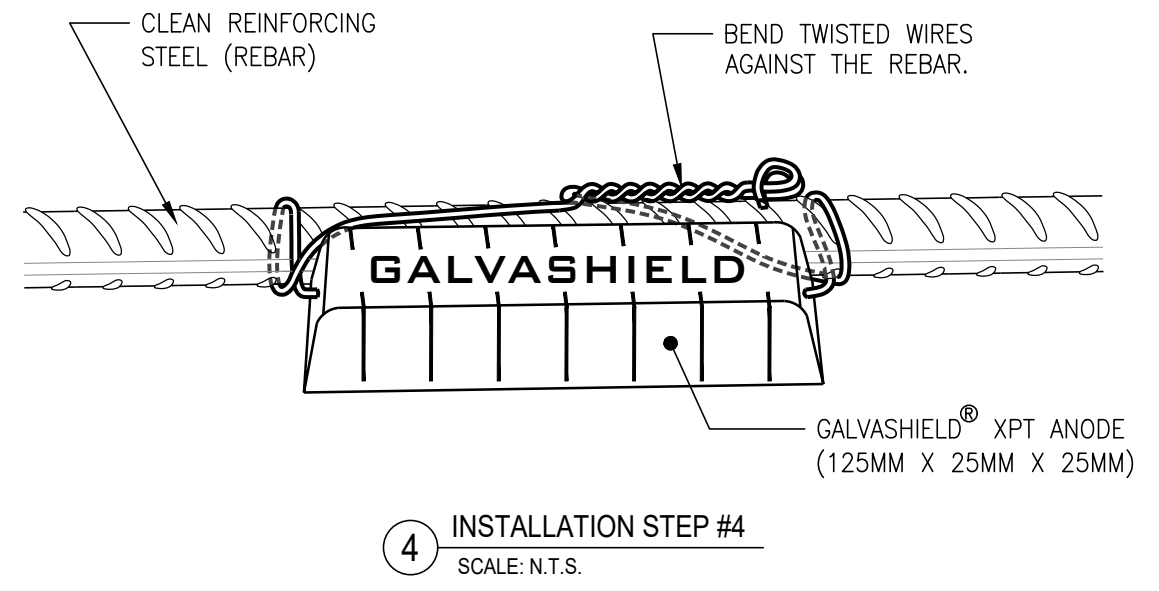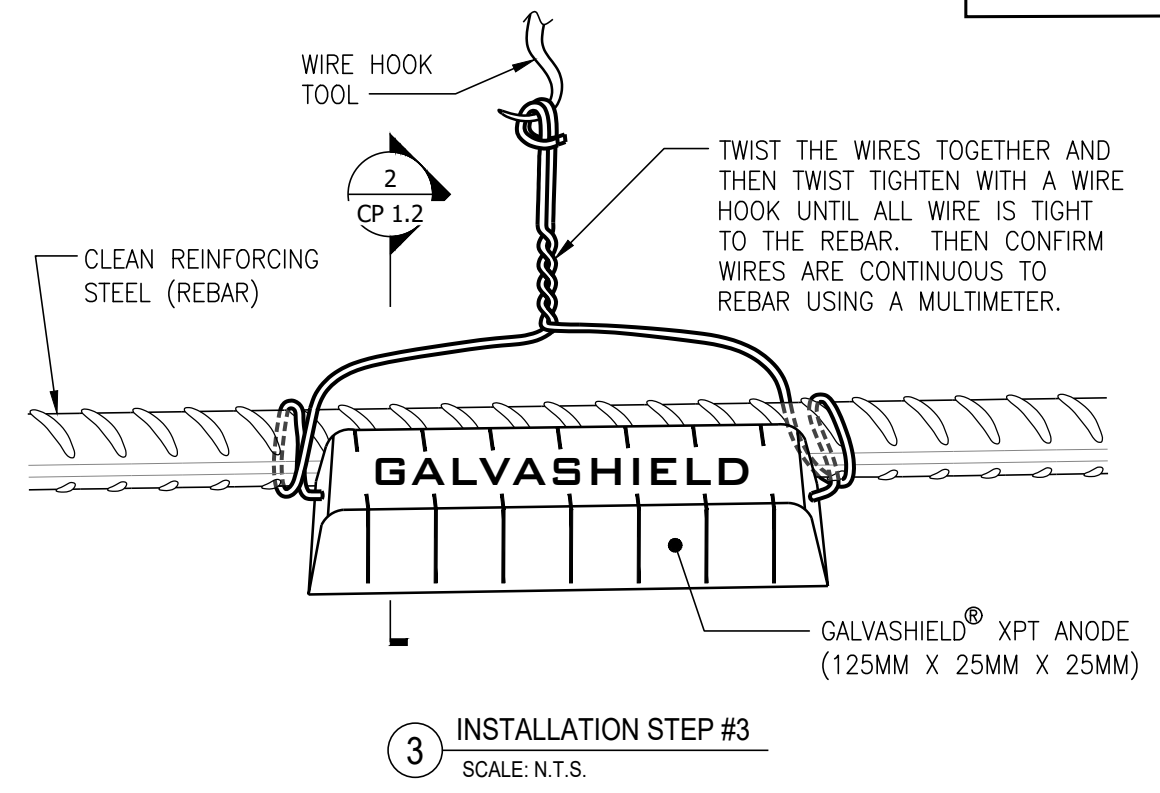

| DRAWING REVISIONS | | | |
|-------------------|---------|------|-------------|
| # | DATE | BY | DESCRIPTION |
| 1 | 6/12/23 | S.Y. | |
| | | | |
| | | | |
| | | | |



**GALVASHIELD® ANODES
CORROSION PROTECTION**


**GALVASHIELD® XPT SINGLE
WIRE CONNECTION
SECTIONS & DETAILS**

VECTOR CORROSION TECHNOLOGIES
800 WINCHESTER ROAD,
SUITE 175,
LEXINGTON, KY 40505
PH: 813-830-7566
VECTOR-CORROSION.COM


PROJECT NO.

DRAWING NO.

CP-1.2

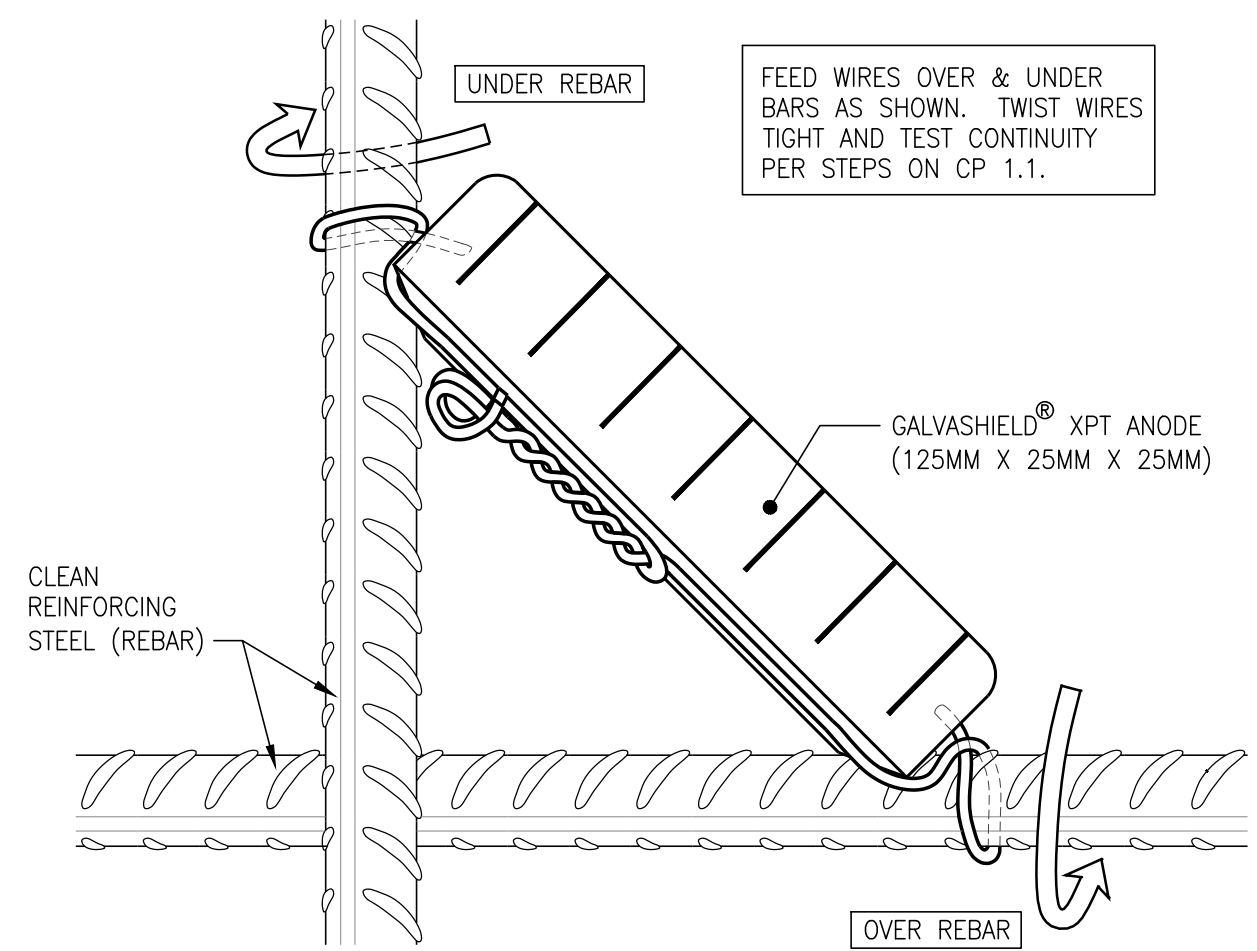

1 ALTERNATE INSTALLATION AT REBAR INTERSECTION
SCALE: N.T.S.

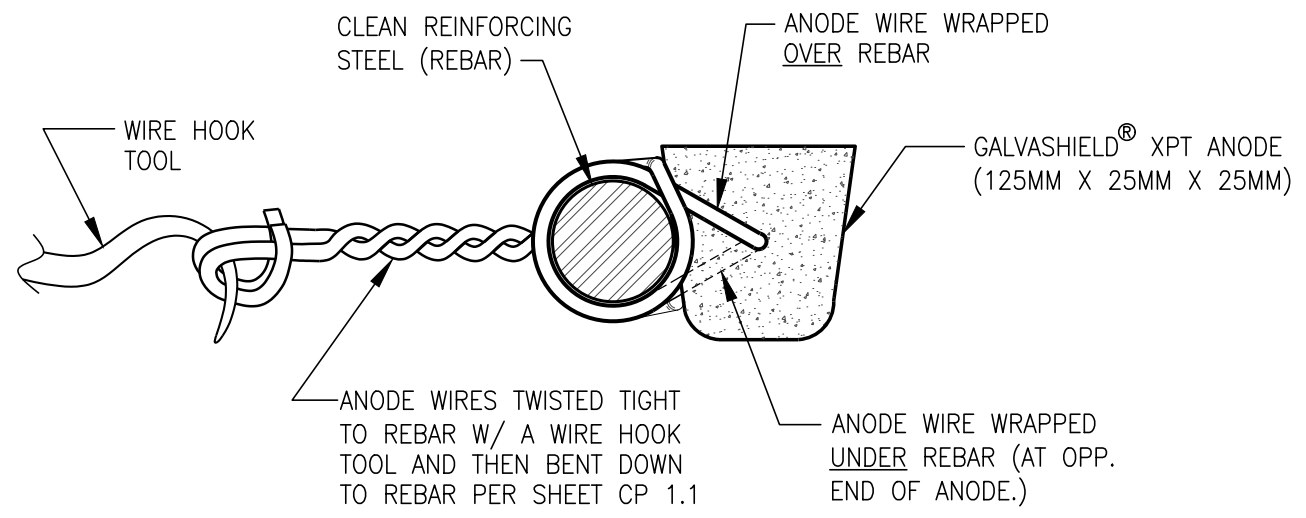

2 SECTION AT ANODE
SCALE: N.T.S.

ANODE ORIENTATION NOTE: ANODES MAY BE INSTALLED AS SHOWN WITH THE WIDER SIDE ON TOP, OR MAY BE ROTATED 180-DEGREES TO HAVE THE WIDER SIDE AT THE BOTTOM.